

Thank you for purchasing FATEK HMI. Before installing or operating the unit, please read this installation guide carefully to ensure correct use.

1. Safety Precautions (Read these precautions before use.)

1.1 **General**


- Unpack and check the delivery for transportation damage. If any damage or deformation is found, please notify the supplier.
- The supplier is not responsible for the disassembled, altered or modified device.
- Never allow fluid or any conductive particles to enter into the HMI. Otherwise, it may damage the HMI, cause fire or malfunction.
- Only qualified personnel may install the HMI, perform maintenance and inspection.
- The liquid crystal inside the LCD panel is a hazardous substance. If the panel is damaged, avoid contact with the leaked liquid crystal. If the liquid crystal spills on clothing or skin, use soap and wash off thoroughly. In case of eye contact the liquid, hold the eye open, flush with plenty water and get medical attention as soon as possible.
- Do not touch any terminals while the power is on. Otherwise, it may cause injury due to electrical shock.
- Disconnect the power supply before installing the HMI, do wiring operation, perform maintenance or inspection. Otherwise, it may cause damage or electrical shock.

1.2 Installation


- The installation may be carried out by qualified personnel only.
- Install the HMI according to the installation procedures.
- Check the power source voltage is within the specified range and the polarity is correct before connecting the HMI.
- Keep signal and power supply cables away from high-voltage, large-current carrying cables.



Make sure the HMI is properly grounded to prevent electrical shock, fire or malfunction.

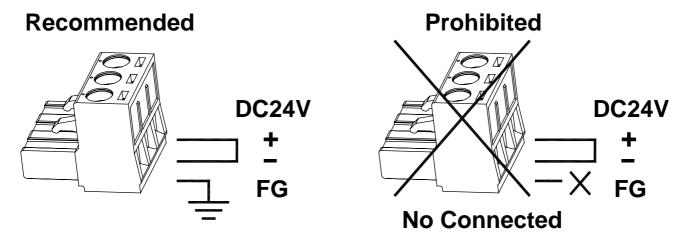

 HMI unit and other equipment should have the same electrical grounding (reference voltage level), otherwise communication errors may occur.

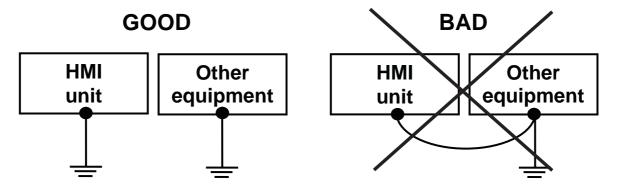


1.3 Operation


- Do not use sharp objects or excessive force to press the touch screen. This
 may damage the touch screen. HMSP070 screen protector can be applied
 to the HMI screen to protect it from damage, for ordering information, please
 contact our sales department.
- Do not use the output signal of the device as any safety function or system emergency stop. It may result in personal injury or equipment damage if a malfunction of the touch occurs.


1.4 Maintenance and Service


- The agreed guarantee applies.
- Only qualified personnel should make repairs and perform maintenance.
- Disconnect the device from the power supply before carrying out cleaning or maintenance.
- Clean the front panel with a soft cloth and mild detergent.
- Please use original replacement spare parts or accessories.

2. Part Names and Dimensions

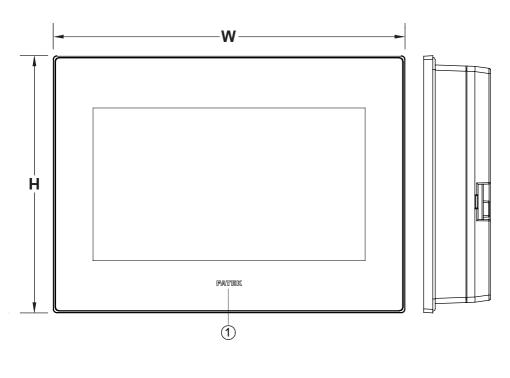



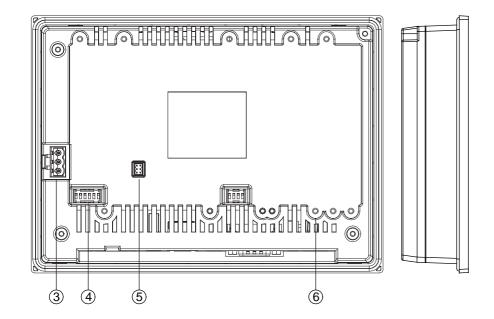




1	Power Indicator Light
2	Mounting Hole
3	Power Connector
(COM3/COM4
4	Termination Switch
Œ	HB1 PLC
5	Connector
6	HB1 PLC Screw Hole
	COM3/COM4:
7	Pluggable Terminal Block
	Terrilliai block
8	USB Connector
	Ethernet RJ45
9	Connector
	(for N/N1 model)
6	Mini USB
10)	Connector
(4)	COM1: DB-9 Male
11)	Connector
6	Audio Phone Jack
2	(for N1 model)
	Micro-SD Card
13	Slot
•	(for N1 model)

W	201.0 mm
Н	147.0 mm
D	38.1 mm


3. Specifications

-	Model	P5070S	P5070N	P5070N1	
	Type of item tested	Control			
	Product Description	Operator Panel			
	Connections to mains		Damasanan		
	supply		Permanent		
	Overvoltage category	II			
	Pollution degree	2			
	Means of Protection	Class III			
UL 61010-1	Environmental conditions	Operating Temp. 0~50°C Storage Temp20~60°C			
Technical	For use in wet locations	No			
Consideration	Equipment mobility	Built in			
Consideration	Operating conditions	Continuous			
	Overall size	201.0 x 147.0 x 38.1 (mm)			
	Weight	610 (g) 630 (g) 650 (g)			
	Marked degree of	,			
	protection	Front panel: IP65 / Rear Case: IP20 to IEC 60529 Type 1 to UL 50E			
	Equipment classification	Industrial, Professional, Commercial			
	Equipment class	Class III			
	Equipment type	Permanently connected, Fixed			
	Equipment type	Connector: D-Sub 9-Pin			
	Serial 1	COM1: RS-232 (TXD, RXD, RTS, CTS)			
		Connector: Pluggable Terminal Block			
	Serial 2	COM3: RS-422/485 (Isolation)			
	551.0.		COM4: RS-485 (Isolation	,	
	LAN		10M/100M	10M/100M	
I/O Port	_		USB2.0 Type-A (Host)	· · · · · · · · · · · · · · · · · · ·	
,	USB	USB2.0 Type mini-B (Device)x1			
	Micro SD			Yes	
	Audio			Yes	
	PLC Extension	HB1 main units + B1 extension modules			
	Termination			1	
	Switch	Yes (For RS-422/485)			
	Power Input	2	24VDC±20% (Isolated Po	ower)	
Power	Consumption 400mA@24VDC				
	Insulation	50MΩ at 500VDC			
	Relative Humidity	10%~90%@ 40°C (non-condensing)			
	Withstand Voltage	AC500V/20mA/1 Min. (between charger & FG terminals)			
	Vibration	5 to 9Hz Half-amplitude: 3.5mm			
Environment		9 to 150 Hz Constant acceleration: 19.6m/s ² (2G)			
		3 directions of X, Y, Z: 10times (IEC61131-2 complaints)			
	Noise Suppression	1000Vp-p, width 1us, rising time 1ns			
	Grounding Resistance	Below 100Ω			
Dimension	Cut-out	191.5 x 137.5 (mm)			


4. Unpacking the Unit

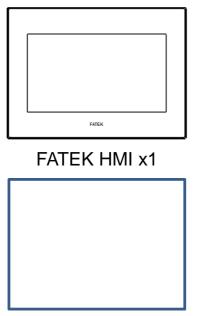





Hook and Screw x4



Power Connector x1





FATEK PLC
Connector Rubber
Cover x1



Pluggable Terminal Block x1


5. Installation Procedures

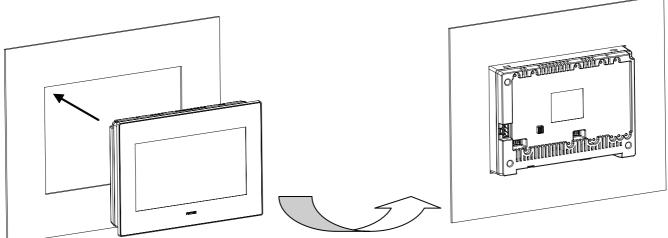

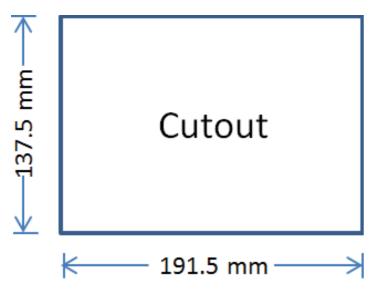

- Push the HMI into the cutout until the waterproof ring contacts the plate.
- Insert a hook into each mounting hole on the HMI, and then tighten the screws evenly with a moderate torque.
- Failure to tighten the screws may cause the HMI to fall, malfunction or short-circuit. Excessive tightening may cause deformation. The necessary torque is about 0.16N⋅m.

6. Power Connection

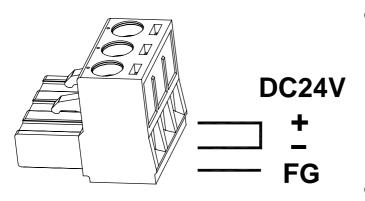


- Be sure to connect the ground FG terminal to a class-3 ground (Ground resistance should not exceed 100Ω). Try to make the ground wire as short as possible.
- Use 28 12 AWG (0.5 1.5 mm²) wire for the power connections.

7. Termination Switch

- P5070S/N/N1 HMI has a built-in termination resistor switch.
 To enable or disable the termination resistor please follow the configuration shown in the table below. The termination switch is for COM3 [RS-422 / RS-485] and COM4 [RS-485].
- Configuration of Termination Resistor Switch.


	Termination Resistor					
No.	COM3 [RS-422]		COM3 [RS-485]		COM4 [RS-485]	
	Enable	Disable	Enable	Disable	Enable	Disable
1	ON	OFF	OFF	OFF	OFF	OFF
2	ON	OFF	OFF	OFF	OFF	OFF
3	ON	OFF	ON	OFF	OFF	OFF
4	ON	OFF	ON	OFF	OFF	OFF
5	OFF	OFF	OFF	OFF	ON	OFF
6	OFF	OFF	OFF	OFF	ON	OFF

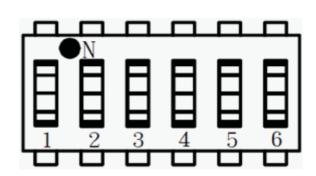

8. Pin-out of COM Ports


DB-9 Male Connector		
PIN#	COM1 [RS-232]	
1	[RS-232] NC ^{*1}	
2	RX	
3	TX	
4	NC	
5	GND	
6	NC	
7	RTS	
8	CTS	
9	NC	

^{*1} NC: No Connection

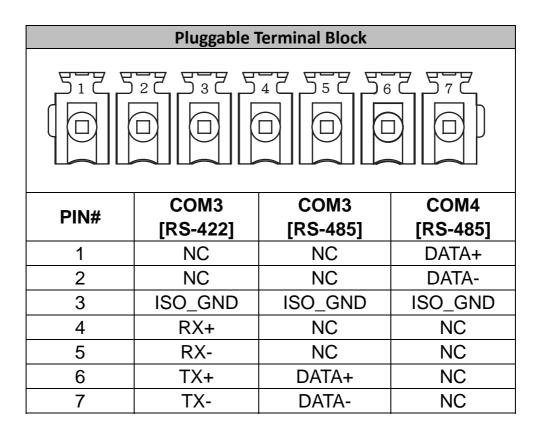

9. PLC Extension Tips

- For compact size and saving space, using FATEK HB1 main units + B1 extension modules is recommended.
- The rubber cover of the PLC connector can be taken off and placed into the termination switch slot.

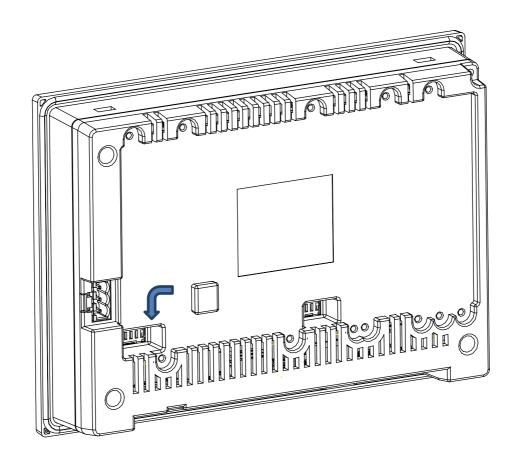

FATEK® AUTOMATION CORPORATION

26FL., NO. 29, SEC. 2, JUNGJENG E. RD.,

DANSHUEI DIST., NEW TAIPEI CITY 25170, TAIWAN, R.O.C

TEL : +886-2-2808-2192
FAX : +886-2-2809-2618
E-mail : sales@fatek.com

tech@fatek.com

Website: www.fatek.com